


FIRST FIX DIAGRAM

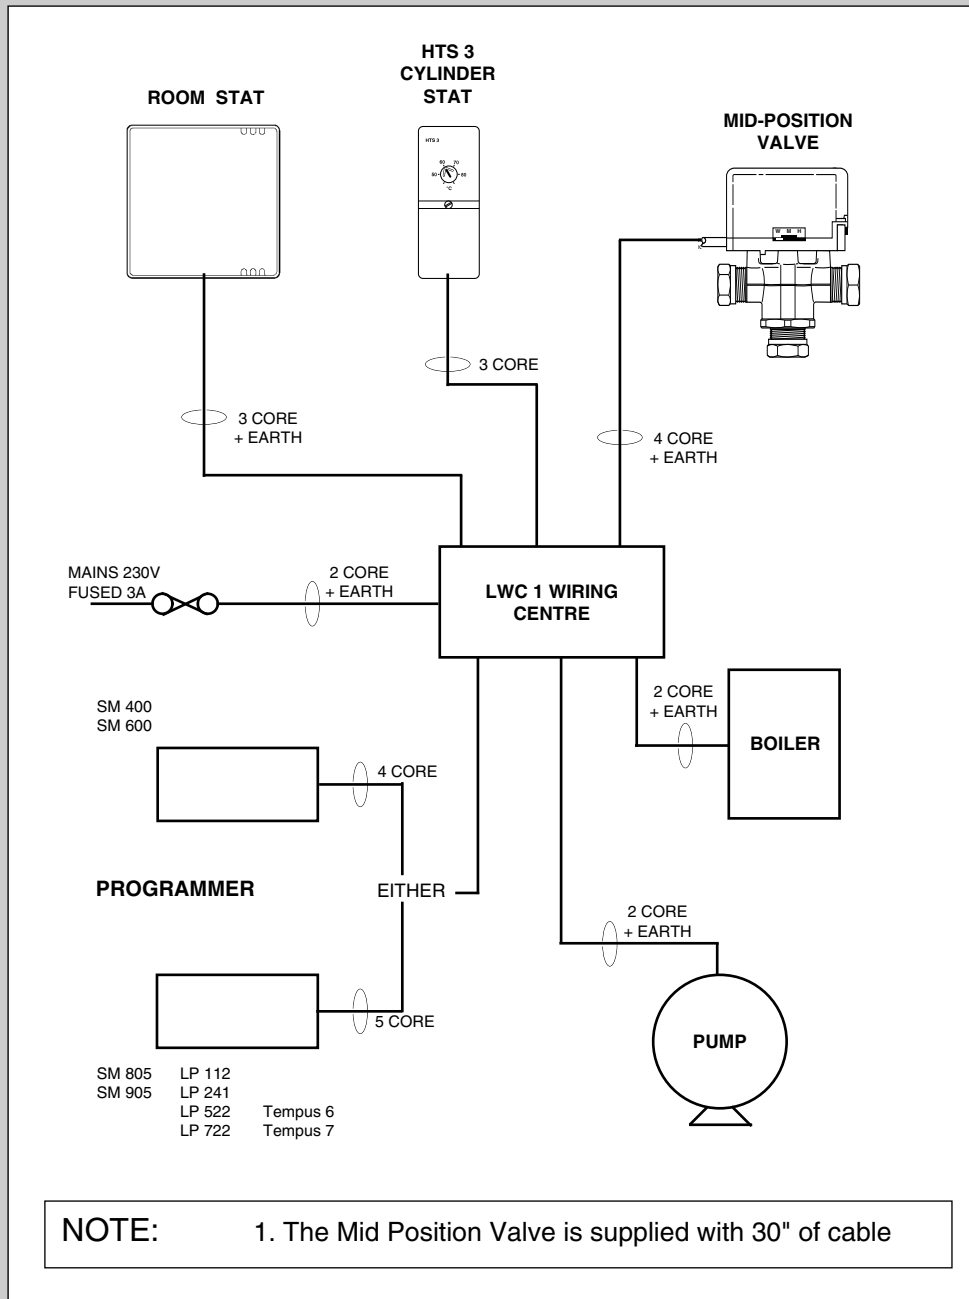


Lifestyle

Heating Control Pack

with

Switchmaster, Lifestyle or Tempus Programmer

**MID POSITION
VALVE PACK
WITH
LWC 1
WIRING
CENTRE**

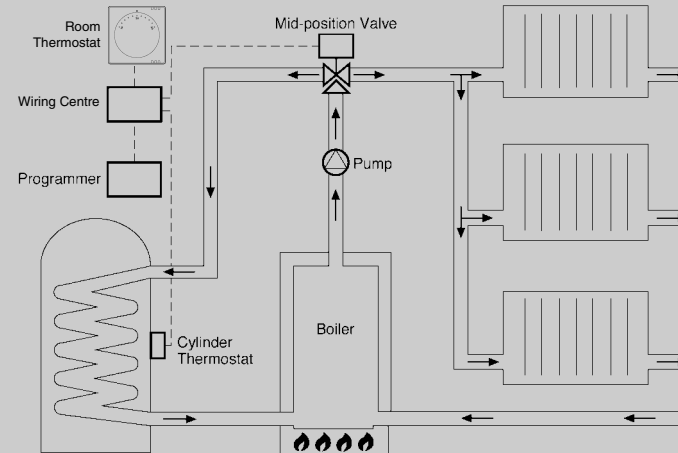

CONTENTS

Programmer

Mid - Position Valve

Room
Thermostat

Cylinder
Thermostat

LWC 1 Wiring
Centre

INSTALLATION AND WIRING GUIDE

Invensys Controls Europe

Customer Service Tel: 0845 130 5522

Technical Helpline Tel: 0845 130 7722

Email: customer.care@invensyscontrols.com

Website: www.draytoncontrols.co.uk

090-670 Iss A

INSTALLATION INSTRUCTIONS

PROGRAMMER

Please refer to separate leaflet.

MOTORISED VALVE

Installation

Install the valve in a clean, dry location where the ambient temperature does not exceed 52°C. Ensure that the motor housing is not below the valve body. The manual lever and motor cover retaining-screw should be left accessible and the valve position indicator visible. Cut connecting copper tubes to allow 10-15mm penetration (22mm valve) or 22-25mm penetration (28mm valve) into the valve body, and ensure tube ends are square and free of burrs. Slip the compression nuts over the ends of the tubes, followed by the copper olives so that these fit within the threaded sections of the nuts. Offer up to the valve body, screw on and tighten the compression nuts by hand until finger tight and then tighten fully using suitable spanner or adjustable wrench. Care must be taken not to over tighten or to put any mechanical force on the plastic parts of the valve.

OPERATION

Lifestyle mid position valves allow the flow of water from the valve inlet to be directed to either of two outlets, or through both at the same time. Signals from room and cylinder thermostats enable the valve's electronic circuitry to close either one of the outlet ports or to hold the swivel seal in the mid-position to leave both outlets open.

MANUAL LEVER

When the manual lever is moved to the right both outlet ports A and B are open. The manual lever is used when filling, venting and draining the installation. To open the valve, the manual lever should be moved from left to right across the valve and then pressed in. When released it will lock in this position. It automatically releases when power is applied to the valve.

VALVE POSITION INDICATOR

In the mid position valve, this indicates which outlet ports are *open*.
 W = Domestic Hot Water (Port B)
 M = Both Water and Heating (Ports A and B)
 H = Central Heating (Port a)

ROOM THERMOSTAT

Location

Care should be taken to mount the thermostat in a position which is not subject to direct sunlight or draughts. Preferably it should be fixed on an inside wall about 1.5m above the floor in a position where it can respond to room temperature but away from the direct influence of radiators or other appliances giving off heat.

Fixing

Remove the dial, undo the screw and lift off cover. Fix the base onto a flat wall or flush mounting single conduit box. If the pattriss is required, fix this first and then mount thermostat base using the screws supplied. Wire to terminal as shown in the diagram opposite.

IMPORTANT

This thermostat requires a neutral and must be earthed.

CYLINDER THERMOSTAT

Positioning

The HTS3 should be installed approximately one third of the way up the hot water cylinder, and at the front for ease of access. With pre-insulated cylinders, mark the position and size, and remove just enough insulation to allow the HTS3 to fit against the metal of the cylinder in the recess formed.

The base of the HTS3 should be held in good contact with the metal of the hot water cylinder.

The plastic covered spring fixing cable should be cut to an unstretched length of approximately 2 1/2" - 3" less than the circumference of the cylinder and the hook and eyelet screwed into the ends. Stretch the cable round the cylinder, above the insulation, and position it in the groove across the front of the HTS3. Engage the hook and eyelet.

Commissioning

The two setting marks outside the temperature scale on the HTS3 provide positive ON and OFF positions to assist with commissioning or checking the system operation. Rotate the setting arrow fully clockwise for ON, and anticlockwise for OFF.

Setting

With a screwdriver, position the setting arrow at the desired nominal hot water temperature. A popular setting is 60°C but if this is not exactly suitable, simply adjust up or down as appropriate.

Frost Protection

If frost protection is required, we recommend that a frost thermostat (RTS3) is fitted in series with a pipe thermostat (PTS1) to provide 'Two Stage' protection.


CONFORMS TO THE ESSENTIAL REQUIREMENTS OF THE FOLLOWING DIRECTIVES:
 89/336/EEC - Electromagnetic compatibility; 73/23/EEC - Low Voltage Directive

See back of this leaflet for details on cable requirements for installation.



MID-POSITION VALVE System with LWC1 Wiring Centre


Wiring Centre - BASIC LINKS

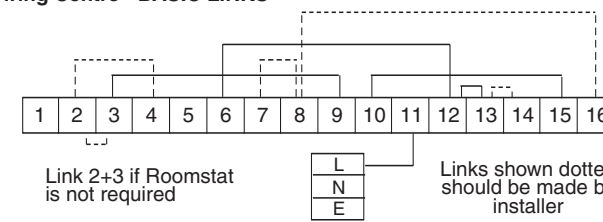


CONNECTIONS

The numbers printed at the tip of each arrow represent the Wiring Centre Terminals to which those leads or terminals should be connected.

Pump




Boiler




* Refer to Boiler Handbook for wiring details of Pump Overrun boilers. Use boiler manufacturers instructions.

Controls

Room Thermostat




Cyl. Thermostat



Programmer

	N	11	8	NOT USED	10	9
Lifestyle LP722 LP522 LP241 LP112 Tempus 6, 7	N	L	1	2	3	4
Switchmaster 400 600	N	L	-	-	3	1
Switchmaster 805 905 9001	N	L	4	2	3	1
				HW OFF	CH OFF	HW ON CH ON

Mains Input 230V 50HZ

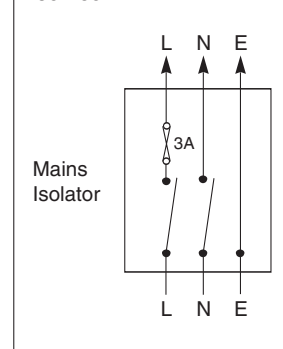

Motorised Valve

	4	7	6	N	E
Drayton 22mm 3 Port Mid Position Valve 28mm 3 Port Mid Position Valve	White	Grey	Orange	Blue	Yellow/Green
Function	CH On	HW Off	Boiler Live & HW On	N	E

Every effort has been made to simplify the instructions and to ensure accuracy. However, the information is provided for guidance only and Invensys Controls Europe are unable to accept liability for incorrect installation.

WHERE ANY DOUBT EXISTS, PLEASE SEEK PROFESSIONAL ADVICE